



TIMELINE

ORDERED

October 26, 2026

RECEIVED

October 28, 2026

ANALYZED

October 29, 2026

SAMPLE

NAME

KLOW 80 mg

EXPECTED

KLOW blend (GHK-Cu, BPC-157, TB-500, KPV)

AMOUNT

1 vial, lyophilized powder

TESTING

CLIENT

Prime X Compounds

TEST TYPE

Content & purity

METHOD

HPLC-UV

CONTENT, HOW MUCH IS IN IT

GHK-Cu

59.6 mg

Label claim: 50 mg

BPC-157

12.44 mg

Label claim: 10 mg

TB-500

10.11 mg

Label claim: 10 mg

KPV

12.00 mg

Label claim: 10 mg

PURITY, HOW CLEAN IT IS

>99.9%

Peptide purity, HPLC-UV peak area


CHROMATOGRAMS

BPC-157 / TB-500


HPLC-UV

GHK-CU / KPV

HPLC-UV

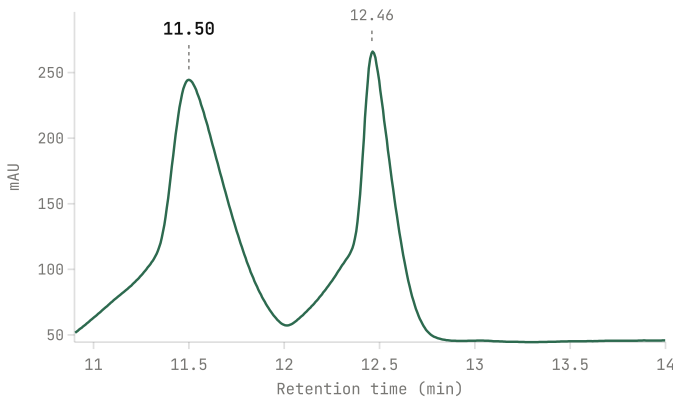

● 11.50 min, BPC-157, 61.4% ● 12.46 min, TB-500, 38.5%

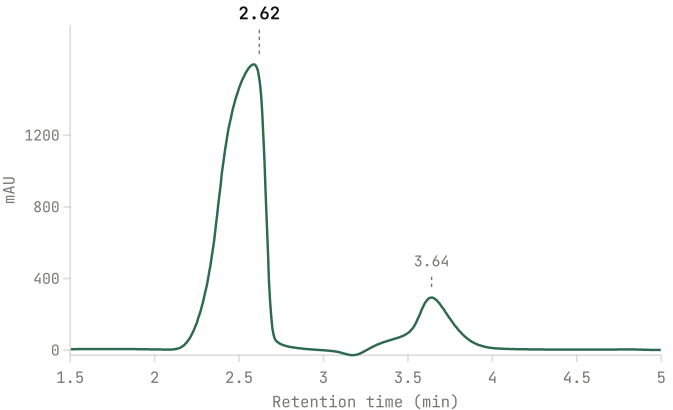

● 2.62 min, GHK-Cu ● 3.64 min, KPV

ANALYST COMMENTS

Blue lyophilized powder, red-cap vial, received sealed. GHK-Cu and KPV were measured on a second HPLC-UV method; both chromatograms are shown.

ANALYST SIGNATURE

Max Barrett

Lab Director, PuriLab Analytical

Analysis date: October 29, 2026

VERIFICATION CODE

KL-AGBS-0EQ9

Verify at purilab.org/verify/KL-AGBS-0EQ9

SCAN TO VERIFY



KL-AGBS-0EQ9

Results apply solely to the sample as received and are not representative of any larger lot, batch, or production run. Findings are limited to the analytes stated above. PuriLab Analytical is an independent testing laboratory, is not CLIA certified or ISO 17025 accredited, does not sell or distribute any substance, and makes no representation as to the safety, legality, or fitness of any material for any use.