CERTIFICATE OF ANALYSIS

PuriLab Analytical

KLOW 80 mg

KL-2026-011 Lot 011026KLO80-BAP Analyzed November 7, 2026



TIMELINE

ORDERED
November 3, 2026

RECEIVED
November 5, 2026

ANALYZED
November 7, 2026

SAMPLE

NAME
KLOW 80 mg

EXPECTED
KLOW blend (GHK-Cu, BPC-157, TB-500, KPV)

AMOUNT
1 vial, lyophilized powder

TESTING

CLIENT
BayArea Peptides

TEST TYPE
Content & purity

METHOD
HPLC-UV

CONTENT, HOW MUCH IS IN IT

GHK-Cu	51.3 mg Label claim: 50 mg
BPC-157	9.16 mg Label claim: 10 mg
TB-500, fragment form (Ac-LKKTETQ)	8.22 mg Label claim: 10 mg
Thymosin beta-4, full length	Not detected
KPV	11.03 mg Label claim: 10 mg


PURITY, HOW CLEAN IT IS

98.4%

Peptide purity, HPLC-UV peak area


CHROMATOGRAMS

BPC-157 / TB-500 — HPLC-UV

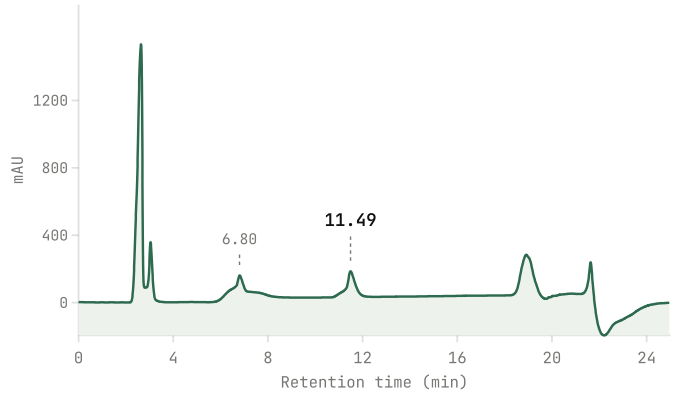

- 11.49 min, BPC-157, 98.4%
- 6.80 min, TB-500 (fragment), >99.9%

GHK-CU / KPV — HPLC-UV

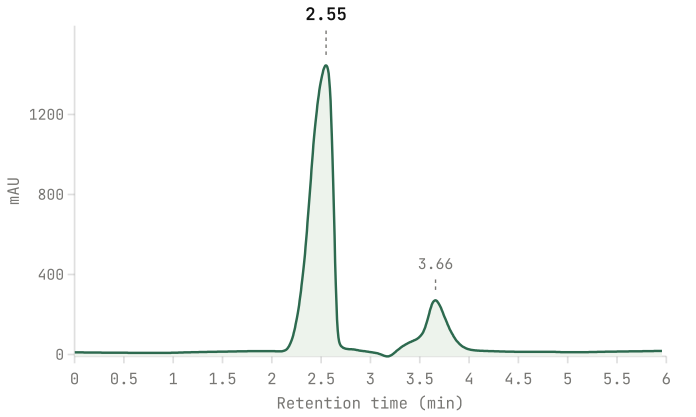

- 2.55 min, GHK-Cu
- 3.66 min, KPV

ANALYST COMMENTS

Blue lyophilized powder, blue flip-cap vial, received sealed. GHK-Cu and KPV were measured on a second HPLC-UV method; both chromatograms are shown.

ANALYST SIGNATURE

Max Barrett
Lab Director, PuriLab Analytical
Analysis date: November 7, 2026

VERIFICATION CODE

KL-YRL3-U6ZN
Verify at purilab.org/verify/KL-YRL3-U6ZN

SCAN TO VERIFY

KL-YRL3-U6ZN

Results apply solely to the sample as received and are not representative of any larger lot, batch, or production run. Findings are limited to the analytes stated above. PuriLab Analytical is an independent testing laboratory, is not CLIA certified or ISO 17025 accredited, does not sell or distribute any substance, and makes no representation as to the safety, legality, or fitness of any material for any use.