CERTIFICATE OF ANALYSIS

PuriLab Analytical

KLOW80 80 mg

KL-2026-012 Lot NOT PROVIDED Analyzed November 15, 2026



TIMELINE

ORDERED
November 9, 2026

RECEIVED
November 11, 2026

ANALYZED
November 15, 2026

SAMPLE

NAME
KLOW80 80 mg

EXPECTED
KLOW80 (GHK-Cu, BPC-157, TB-500, KPV)

AMOUNT
1 vial, lyophilized powder

TESTING

CLIENT
4Ever Research

TEST TYPE
Content & purity

METHOD
HPLC-UV

CONTENT, HOW MUCH IS IN IT

GHK-Cu	**50.6** mg	Label claim: 50 mg
BPC-157	**11.72** mg	Label claim: 10 mg
TB-500 (full-length TB4)	**9.93** mg	Label claim: 10 mg
KPV	**10.71** mg	Label claim: 10 mg


PURITY, HOW CLEAN IT IS

99.5%

Peptide purity, HPLC-UV peak area


CHROMATOGRAMS

BPC-157 / TB-500 — HPLC-UV

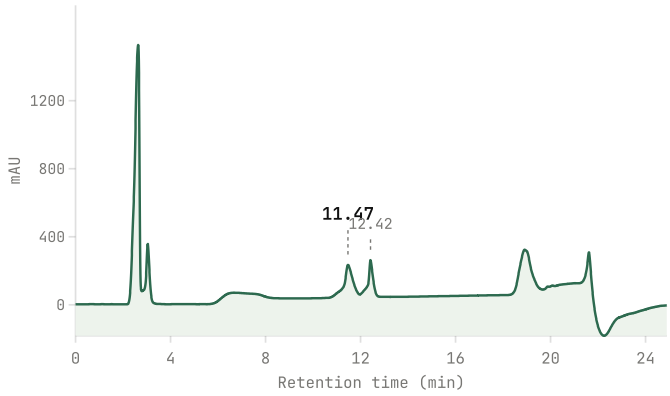

- 11.47 min, BPC-157, 59.7%
- 12.42 min, TB-500 (full-length TB4), 39.8%

GHK-CU / KPV — HPLC-UV

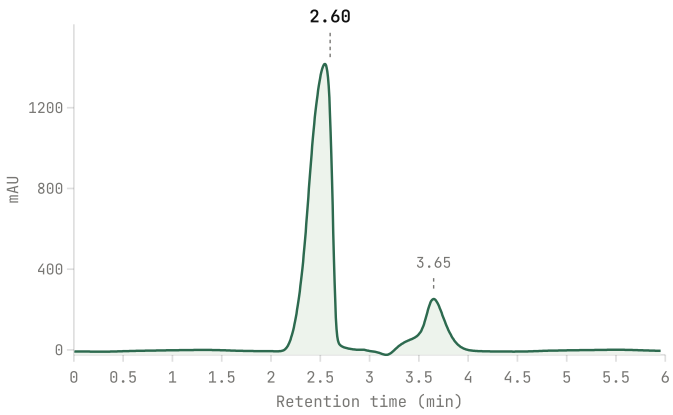

- 2.60 min, GHK-Cu
- 3.65 min, KPV

ANALYST COMMENTS

Blue lyophilized powder, orange-cap vial, received sealed. GHK-Cu and KPV were measured on a second HPLC-UV method; both chromatograms are shown.

ANALYST SIGNATURE

Max Barrett
Lab Director, PuriLab Analytical
Analysis date: November 15, 2026

VERIFICATION CODE

KL-MLAS-2QX8

Verify at purilab.org/verify/KL-MLAS-2QX8

SCAN TO VERIFY

KL-MLAS-2QX8

Results apply solely to the sample as received and are not representative of any larger lot, batch, or production run. Findings are limited to the analytes stated above. PuriLab Analytical is an independent testing laboratory, is not CLIA certified or ISO 17025 accredited, does not sell or distribute any substance, and makes no representation as to the safety, legality, or fitness of any material for any use.