CERTIFICATE OF ANALYSIS

PuriLab Analytical

KLOW 80 mg

KL-2026-014 Lot Amelia-Spooktacular Analyzed November 15, 2026



TIMELINE		SAMPLE		TESTING	
ORDERED	November 10, 2026	NAME	KLOW 80 mg	CLIENT	Jessica Bartlow
RECEIVED	November 13, 2026	EXPECTED	KLOW blend (GHK-Cu, BPC-157, TB-500, KPV)	TEST TYPE	Content & purity
ANALYZED	November 15, 2026	AMOUNT	1 vial, lyophilized powder	METHOD	HPLC-UV

CONTENT, HOW MUCH IS IN IT

GHK-Cu	66.6 mg	Label claim: 50 mg
BPC-157	12.95 mg	Label claim: 10 mg
TB-500 (full-length TB4)	10.90 mg	Label claim: 10 mg
KPV	11.28 mg	Label claim: 10 mg


PURITY, HOW CLEAN IT IS

99.4%

Peptide purity, HPLC-UV peak area


CHROMATOGRAMS

BPC-157 / TB-500 HPLC-UV

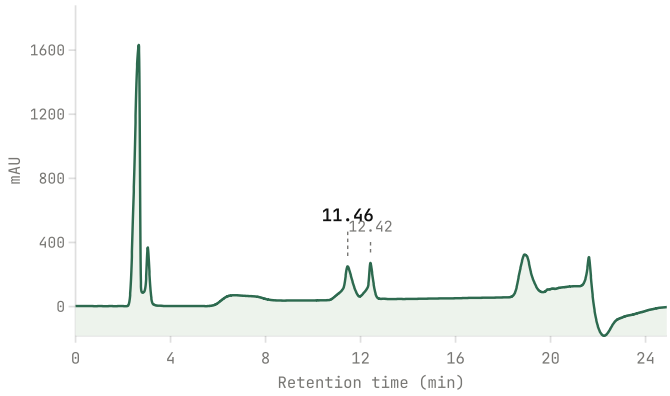

- 11.46 min, BPC-157, 59.8%
- 12.42 min, TB-500 (full-length TB4), 39.6%

GHK-CU / KPV HPLC-UV

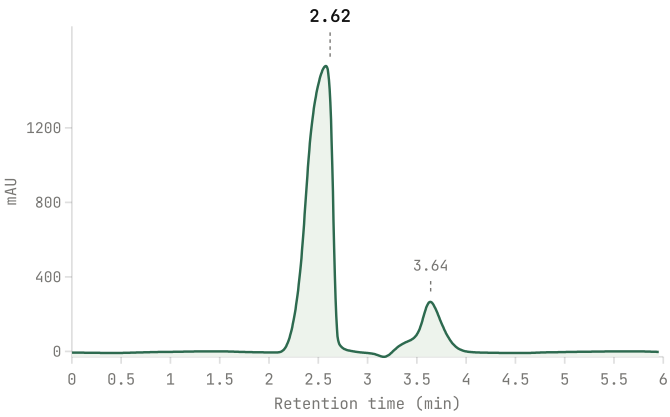

- 2.62 min, GHK-Cu
- 3.64 min, KPV

ANALYST COMMENTS

Blue lyophilized powder, gray-cap vial, received sealed. GHK-Cu and KPV were measured on a second HPLC-UV method; both chromatograms are shown.

ANALYST SIGNATURE

Max Barrett
Lab Director, PuriLab Analytical
Analysis date: November 15, 2026

VERIFICATION CODE

KL-Z3ND-U0YT

Verify at purilab.org/verify/KL-Z3ND-U0YT

SCAN TO VERIFY

KL-Z3ND-U0YT

Results apply solely to the sample as received and are not representative of any larger lot, batch, or production run. Findings are limited to the analytes stated above. PuriLab Analytical is an independent testing laboratory, is not CLIA certified or ISO 17025 accredited, does not sell or distribute any substance, and makes no representation as to the safety, legality, or fitness of any material for any use.