CERTIFICATE OF ANALYSIS

PuriLab Analytical

KLOW 80 mg

KL-2026-020 Lot NOT PROVIDED Analyzed November 11, 2026



TIMELINE

ORDERED
October 29, 2026

RECEIVED
November 4, 2026

ANALYZED
November 11, 2026

SAMPLE

NAME
KLOW 80 mg

EXPECTED
KLOW blend (GHK-Cu, BPC-157, TB-500, KPV)

AMOUNT
2 vials (same product, conformity), lyophilized powder

TESTING

CLIENT
New Wave Aminos

TEST TYPE
Content & purity, fentanyl, conformity

METHOD
HPLC-UV

CONTENT, HOW MUCH IS IN IT

GHK-Cu	76.0 mg	Label claim: 50 mg
BPC-157	12.73 mg	Label claim: 10 mg
TB-500 (fragment)	9.90 mg	Label claim: 10 mg
KPV	11.44 mg	Label claim: 10 mg

PURITY, HOW CLEAN IT IS

99.2%

Average of 2 bottles of the same product. Peptide purity, HPLC-UV peak area.

FENTANYL

NOT DETECTED

Screening cutoff 20 ng/mL


CONFORMITY **DOES NOT CONFORM**

The bottles contain the same four components but do not match on content: bottle 2 holds 10-23% more of each than bottle 1. Content and purity above are the average of the two. Chromatograms show bottle 1. Bottle 1 received November 4, 2026, analyzed November 6, 2026. Bottle 2 received November 10, 2026, analyzed November 11, 2026.

Vial	Content	Purity
Bottle 1	GHK-Cu 70.8 / BPC-157 11.48 / TB-500 8.89 / KPV 10.89 mg	99.2%
Bottle 2	GHK-Cu 81.2 / BPC-157 13.97 / TB-500 10.91 / KPV 11.98 mg	99.2%
Average	**GHK-Cu 76.0 / BPC-157 12.73 / TB-500 9.90 / KPV 11.44 mg**	**99.2%**


CHROMATOGRAMS

BPC-157 / TB-500 HPLC-UV

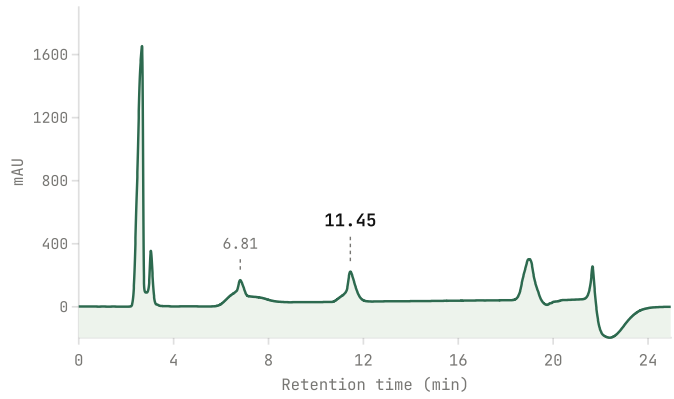

● 11.45 min, BPC-157, 72.8% ● 6.81 min, TB-500 (fragment), 26.4%

GHK-CU / KPV HPLC-UV

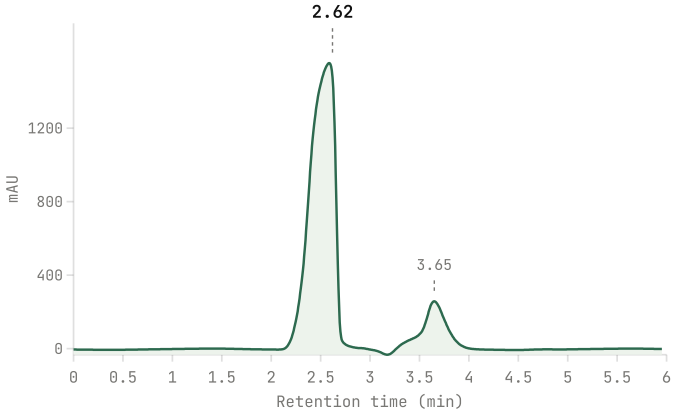

● 2.62 min, GHK-Cu ● 3.65 min, KPV

ANALYST COMMENTS

Blue lyophilized powder, black-cap vials, received sealed. GHK-Cu and KPV were measured on a second HPLC-UV method; both chromatograms are shown (bottle 1).

ANALYST SIGNATURE

Max Barrett
Lab Director, PuriLab Analytical
Analysis date: November 11, 2026

VERIFICATION CODE

KL-X9U9-CWLP
Verify at purilab.org/verify/KL-X9U9-CWLP

SCAN TO VERIFY

KL-X9U9-CWLP

Results apply solely to the sample as received and are not representative of any larger lot, batch, or production run. Findings are limited to the analytes stated above. PuriLab Analytical is an independent testing laboratory, is not CLIA certified or ISO 17025 accredited, does not sell or distribute any substance, and makes no representation as to the safety, legality, or fitness of any material for any use.